


# Particle Size Distribution Report

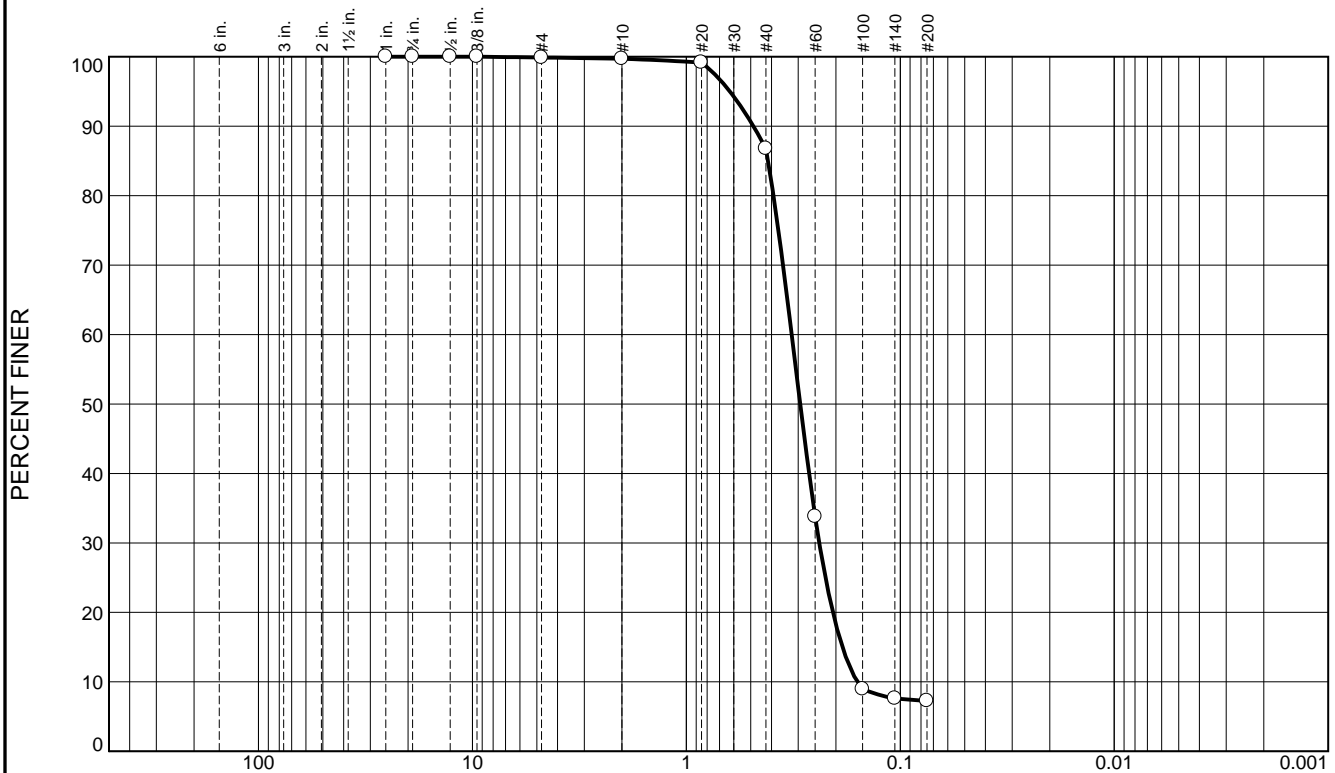

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	0.0	0.1	0.2	12.9	79.6	7.2	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1	100.0		
.75	100.0		
.5	100.0		
.375	100.0		
#4	99.9		
#10	99.7		
#20	99.2		
#40	86.8		
#60	33.8		
#100	9.0		
#140	7.6		
#200	7.2		

\* (no specification provided)

## Material Description

Fine to medium grained, SLIGHTLY SILTY SAND

## Atterberg Limits

PL= LL= PI=

## Coefficients

D<sub>90</sub>= 0.4863 D<sub>85</sub>= 0.4152 D<sub>60</sub>= 0.3219  
D<sub>50</sub>= 0.2938 D<sub>30</sub>= 0.2391 D<sub>15</sub>= 0.1866  
D<sub>10</sub>= 0.1589 C<sub>u</sub>= 2.03 C<sub>c</sub>= 1.12

## Classification

USCS= SP-SM AASHTO=

## Remarks

Location: BI-PB-148-12 A  
Sample Number: 6480 (12)

Depth: 2.1'

Date: 12/07/12

**Thompson Engineering**

**Mobile, Alabama**

Client: CDM/Thompson Engineering JV  
Project: MsCIP Barrier Island Restoration GT

Project No: 1221110095

Figure